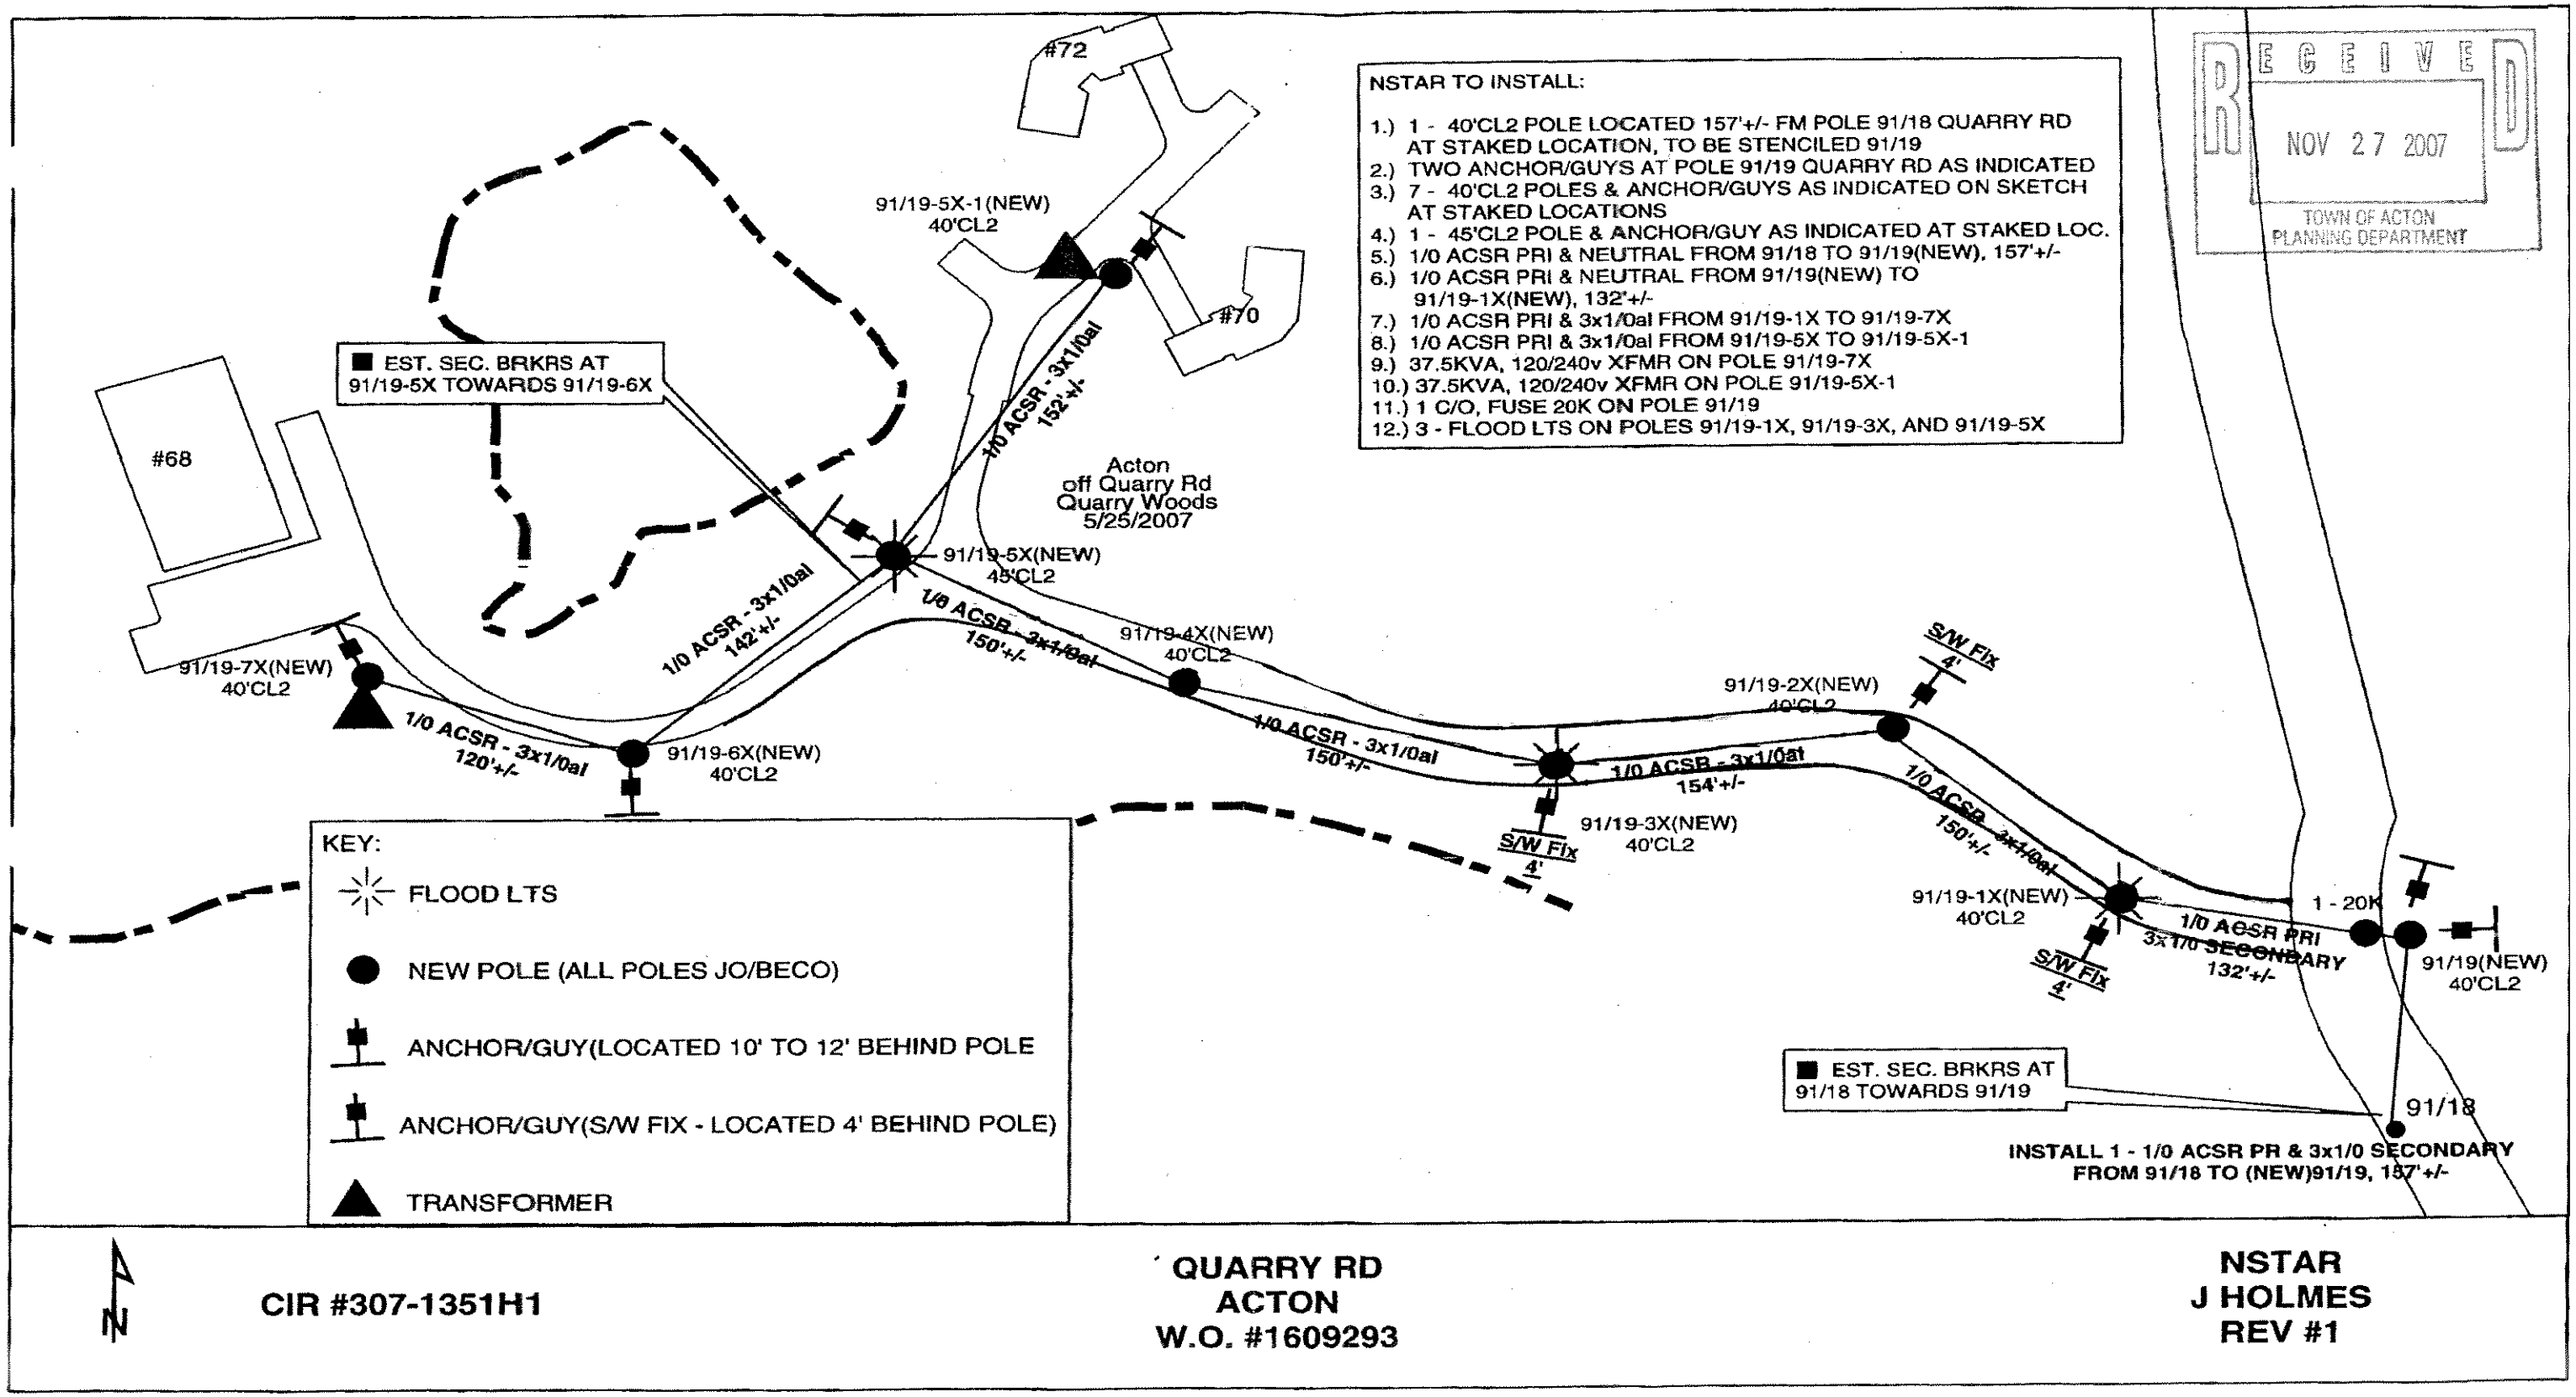

NSTAR TO INSTALL:

1.) 1 - 40'CL2 POLE LOCATED 157'+/- FM POLE 91/18 QUARRY RD AT STAKED LOCATION, TO BE STENCILED 91/19
2.) TWO ANCHOR/GUYS AT POLE 91/19 QUARRY RD AS INDICATED
3.) 7 - 40'CL2 POLES & ANCHOR/GUYS AS INDICATED ON SKETCH AT STAKED LOCATIONS
4.) 1 - 45'CL2 POLE & ANCHOR/GUY AS INDICATED AT STAKED LOC.
5.) 1/0 ACSR PRI & NEUTRAL FROM 91/18 TO 91/19(NEW), 157'+/-
6.) 1/0 ACSR PRI & NEUTRAL FROM 91/19(NEW) TO 91/19-1X(NEW), 132'+/-
7.) 1/0 ACSR PRI & 3x1/0al FROM 91/19-1X TO 91/19-7X
8.) 1/0 ACSR PRI & 3x1/0al FROM 91/19-5X TO 91/19-5X-1
9.) 37.5KVA, 120/240v XFMR ON POLE 91/19-7X
10.) 37.5KVA, 120/240v XFMR ON POLE 91/19-5X-1
11.) 1 C/O, FUSE 20K ON POLE 91/19
12.) 3 - FLOOD LTS ON POLES 91/19-1X, 91/19-3X, AND 91/19-5X

RECEIVED
NOV 27 2007
TOWN OF ACTON
PLANNING DEPARTMENT

N

CIR #307-1351H1

QUARRY RD
ACTON
W.O. #1609293

NSTAR
J HOLMES
REV #1