


WALL NOTES

- FIRECODE GYPSUM BOARD IN A ONE OR TWO-HOUR RATED PARTITION MUST BEAR THE U.L. CLASSIFICATION.
- ALL FIRE AND SMOKE RESISTANT SEPARATIONS ARE TO EXTEND TO THE UNDERSIDE OF FLOOR OR ROOF DECK ABOVE, TYPICAL.
- FOR SMOKE RESISTANT SEPARATIONS PROVIDE FIRE SAFING AND SEALANT AT FLOOR, ROOF DECK AND ALL PENETRATIONS TO PREVENT THE PASSAGE OF SMOKE.
- FOR ALL FIRE RATED PARTITIONS PROVIDE FIRE SAFING AND SEALANT AT FLOOR, ROOF DECK AND ALL PENETRATIONS TO PREVENT THE PASSAGE OF SMOKE. THE FIRE SAFING AND SEALANT SYSTEM MUST MAINTAIN THE RATING OF THE SEPARATION.
- AT ALL NON-RATED PARTITIONS, FILL ALL VOIDS INCLUDING METAL DECK FLUTES WHERE PARTITIONS MEET THE STRUCTURE ABOVE WITH BATT INSULATION.
- AT ALL NON-RATED PARTITIONS, FILL ALL VOIDS BETWEEN PIPES, ELECTRICAL CONDUIT, DUCTWORK, ETC. WHERE THEY PENETRATE WALLS WITH BATT INSULATION.
- PROVIDE SMOKE DAMPERS AT ALL MECHANICAL PENETRATIONS THROUGH ONE HOUR FIRE RATED SMOKE BARRIERS.
- PROVIDE FIRE DAMPERS AT ALL MECHANICAL PENETRATIONS THROUGH TWO HOUR FIRE RATED PARTITIONS.
- EXTEND ALL METAL STUD PARTITIONS TO THE UNDERSIDE OF DECK/ STRUCTURE, UNLESS OTHERWISE NOTED.

ABBREVIATIONS

ABOVE FINISH FLOOR	A.F.F.	INCH OR INCHES	IN.
ACOUSTIC, ACOUSTICAL	AC.	INCLUDE, INCLUDING	INCL.
ACROUSTICAL TILE	AC-T.	INFORMATION	INFO.
ADDITION	ADDN	INSIDE DIAMETER	I.D.
AIR CONDITIONING	A/C.	INSULATION	INSUL.
AIR HANDLING UNIT	A.H.U.	INTERIOR	INT.
ALTERNATE	ALT.	KICK PLATE	K.P.
ALUMINUM	ALUM.	LAB	LAB.
ALUMINUM FRAME	ALUM. FR.	LAVATORY	LAV.
ANCHOR, ANCHORAGE	ANCH.	LIGHTING	LTG.
ANCHOR BOLTS	ANCH. B.	MACH.	MACH.
AND	&	MAINTENANCE	MAINT.
ANGLE	ANG.	MANUFACTURER	M.F.
ANODIZED	ANOD.	MARKER BOARD	M.B.
APPROVED	APPR.	MASONRY	MAS.
ARCHITECT, ARCHITECTURAL	ARCH.	MASONRY OPENING	M.O.
ASSISTOR	ASST.	MATERIAL	MAT.
ASPHALT	ASPH.	MECHANICAL	M.ECH.
ASSEMBLY	ASST.	METAL	MET.
ASSISTANT	ASST.	METAL DECK	M.D.
AT	@	MISCELLANEOUS	MISC.
AUTOMATIC	AUTO	NORTH	N.
BEAM	BM	NOT IN CONTRACT	N.I.C.
BEARING	BRG.	NOT TO SCALE	N.T.S.
BETWEEN	BET.	NUMBER	NO.
BEVEL, BEVELED	BEV.	OFFICE	OFF.
BET.	BET.	ON CENTER	O.C.
BLOCK	BLK.	OPPOSITE HAND	O.H.
BLOCKING	BLKG.	OUTSIDE DIAMETER	O.D.
BOARD	BD.	PAINTED	PTD.
BOTTOM	BOTT.	PAIR	PR.
BOTTOM OF	B.O.	PAPER TOWEL DISPENSER	P.T.D.
BRICK EXPANSION JOINT	B.E.J.	PASSAGE	PASS.
BUILDING	BLDG.	PERPENDICULAR	PERP.
BUILT UP ROOFING	B.U.R.	PLASTER	PLAS.
CABINET	CAB.	PLASTIC LAMINATE	PL.
CABINET UNIT HEATER	C.U.H.	PLATE	PLT.
CAPACITY	CAP.	PLUMBING	PLUMB.
CEILING	CLG.	PLYWOOD	PLYWD.
CEILING HEIGHT	CLG.HT.	POLYVINYLCHLORIDE	PVC
CEMENT	CEM.	PRECAST	PC
CENTER	CTR.	PRECAST EXPANSION JOINT	P.E.J.
CENTERLINE	CL	PREFABRICATED	PREFAB.
CERAMIC TILE	CER.T.	QUANTITY	QTY.
CHAIRLIFT	C.H.	QUARRY TILE	Q.T.
CHANNEL	C. CH.	RAD.	RAD.
CLOSED	C.	RAIN WATER CONDUCTOR	RWC
COLUMN	COL.	RECEIVING	RECV.
CONCRETE	CONC.	REFRIGERATOR	REFR.
CONFERENCE	CONF.	REINFORCE	REINF.
CONTROL JOINT	C.J.	RESURFACE	RESURF.
CONTRACTOR	CONTR.	REVISED, REVISION	REV.
CORRIDOR	CORR.	RISER	R.
COURSE, COURSES	CRS.	ROOF DRAIN	R.D.
		ROOM	R.M.
		ROBE HOOK	R.H.
		SANITARY NAPKIN DISPENSER	S.N.D.
		SANITARY NAPKIN RECEPTACLE	S.N.R.
		SCHEDULE	SCHED.
		SCUPPER	SC.
		SECTION	SECT.
		SEISMIC JOINT	S.J.
		SHEET	SHT.
		SIMILAR	SIM.
		SOAP DISPENSER	S.D.
		SOUND TRANSMISSION CLASS	S.T.C.
		SPECIFICATIONS	SPEC.
		SPLASH BLOCK	S.B.
		SQUARE	SQ.
		SQUARE FEET	S.F.
		STAINLESS STEEL	SS
		STANDARD	STD.
		STEEL	STL.
		STORAGE	STR.
		STRUCTURAL	STRUCT.
		STRUCTURAL STEEL	S.STL.
		SUSPEND, SUSPENSION	SUSP.
		T.B.D.	T.B.D.
		THROUGH	THRU.
		T.O.	T.O.
		T.P.D.	T.P.D.
		T.G.	T.G.
		T.O.	T.O.
		TYPICAL	TYP.
		UNDERWRITER'S LABORATORY	UL.
		UNIT HEATER	U.H.
		UNIT VENTILATOR	U.V.
		UNLESS OTHERWISE NOTED	U.O.N.
		VENT THROUGH ROOF	VTR.
		VESTIBULE	VEST.
		VINYL COMPOSITION TILE	VCT.
		W.P.	W.P.
		W.H.F.	W.H.F.
		W.B.D.	W.B.D.
		W/	W/
		W.D.	W.D.


PROJECT WALL TYPES

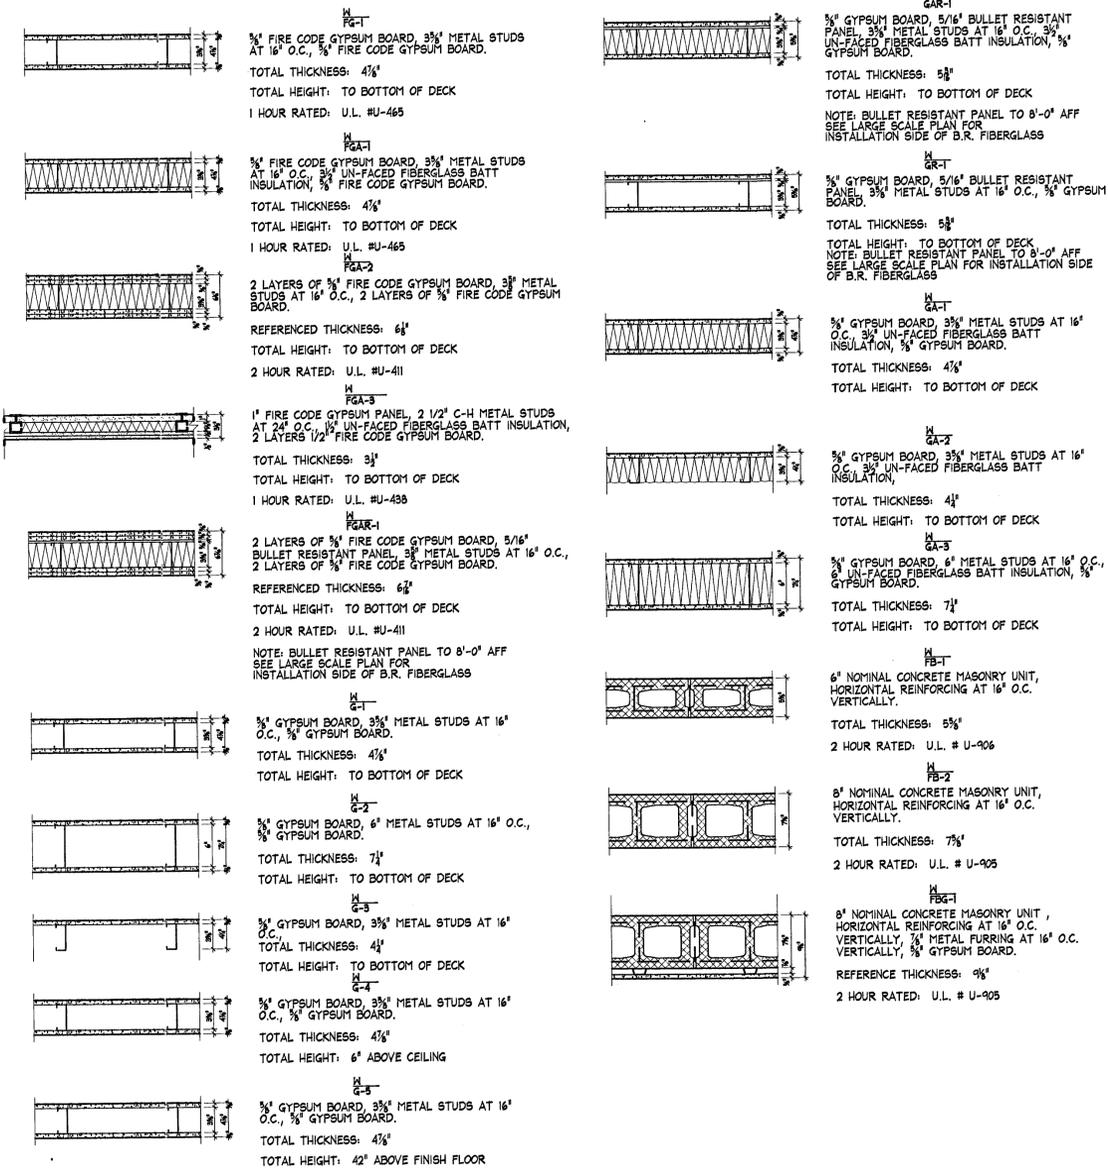

GENERAL NOTES

- CONTRACTOR TO TAKE AND VERIFY ALL DIMENSIONS AND CONDITIONS ON THE JOB AND SHALL BE HELD RESPONSIBLE FOR THE SAME.
- ALL NOTES AND DIMENSIONS DESIGNATED AS TYPICAL APPLY TO ALL SIMILAR CONDITIONS THROUGHOUT THE PROJECT.
- ALL DIMENSIONS ARE TO FACE OF MASONRY, FACE OF METAL STUD AND CENTERLINE OF STRUCTURAL STEEL UNLESS OTHERWISE NOTED.
- ROOFING CONTRACTOR TO VERIFY QUANTITY AND LOCATION OF FLASHINGS, AND TO FLASH ACCORDING TO MANUFACTURER'S SPECIFICATIONS.
- PROVIDE A 1" BULLNOSE AT ALL EXPOSED CONCRETE MASONRY UNIT CORNERS.
- FOR MASONRY REINFORCEMENT SEE SPECIFICATIONS AND STRUCTURAL DRAWINGS.
- ALL DOOR FRAME EDGES SHALL BE LOCATED 4" FROM WALL INTERSECTIONS UNLESS OTHERWISE NOTED.
- SEE STRUCTURAL DRAWINGS AND FINISH PLANS FOR LOCATION OF DEPRESSIONED STRUCTURAL CONCRETE SLABS.
- THE REQUIREMENTS FOR SEISMIC LOADS HAVE BEEN INCORPORATED INTO THE DESIGN OF THE STRUCTURAL, MECHANICAL AND SUSPENDED CEILING SYSTEMS AS REQUIRED FOR THE HIGH CONSTRUCTION.
- SIGNAGE SHALL BE PLACED ON THE WALL ADJACENT TO THE LEVER SIDE OF A ROOM DOOR AT A HEIGHT OF 5'-0" A.F.F.
- FOR EXTERIOR MASONRY CONTROL JOINTS REFER TO THE EXTERIOR ELEVATION SHEETS.
- FOR INTERIOR MASONRY EXPANSION JOINTS, JOINTS SHALL BE PLACED AS IDENTIFIED BY THE SPECIFICATION, PREFERABLY AT THE JUNCTION OF WALLS FIRST AND THEN BY THE REQUIRED DISTANCES. PROVIDE A CONTROL JOINT AT ALL EDGES WHERE MASONRY ABUTS STRUCTURAL STEEL.
- ELECTRICAL CONTRACTOR TO COORDINATE PLACEMENT OF ELEC./ DATA OUTLETS AND SWITCHES WITH THE LOCATION OF CASEWORK. REFER TO CASEWORK DRAWINGS AND ELECTRICAL DRAWINGS.
- ALL SPRINKLER PIPING TO BE LOCATED ABOVE FINISH CEILING UNLESS OTHERWISE NOTED.
- SPRINKLER HEADS SHALL BE LOCATED IN THE CENTER OF CEILING PADS.
- EXPOSED SPRINKLER INSTALLATION SHALL BE CAREFULLY COORDINATED IN THE FIELD TO AVOID CONFLICTS WITH LIGHTING AND OTHER CEILING MOUNTED EQUIPMENT.
- ALL RATED DOORS SHALL HAVE POSITIVE LATCHING LOCKSETS OR LATCHES AND CLOSERS.
- ALL DOOR LEVERS ON DOORS LEADING TO HAZARDOUS SPACES SHALL BE KNURLED.
- ALL DOORS EXITING 100 OR MORE PERSONS SHALL HAVE PANIC EXIT DEVICES.
- HANDICAPPED ACCESSIBLE DOOR HARDWARE SHALL COMPLY WITH CABOVANSI A117.1 1992 AND UFAS 1988.
- METAL STUD CONTRACTOR TO PROVIDE AND COORDINATE PLACEMENT OF METAL STUD SLIP TRACKS AT ALL STUD WALLS BUILT ON TOP OF OR UNDER STRUCTURAL STEEL BRACING FRAMES, TYPICAL.
- PROVIDE AN ALUMINUM DIVIDER STRIP AT ALL DOOR THRESHOLDS WHERE TWO DIFFERENT FINISHES MEET UNLESS OTHERWISE NOTED.
- METAL STUD CONTRACTOR TO PROVIDE AND COORDINATE PLACEMENT AND BLOCKING FOR ALL WALL MOUNTED ELEMENTS ON METAL STUD WALL CONSTRUCTION, TYPICAL.

FIXTURE MOUNTING HEIGHTS

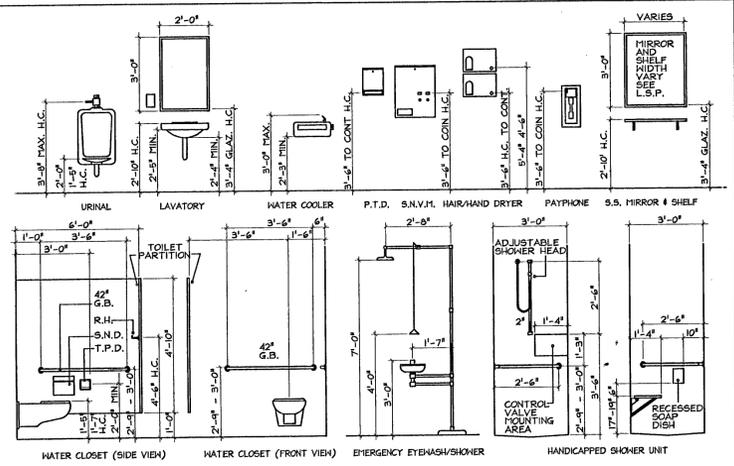

KEY FOR TYPES

F = FLOOR	C = POURED IN PLACE CONCRETE
D = DECK	MD = METAL DECK
M = WALL	P = FIRE RATED
	PC = PRECAST CONCRETE PLANK
C = CEILING	A = ATTENUATION INSULATION
	B = BLOCK (CONCRETE MASONRY UNIT)
	FR = FIRE RATED
	G = GYPSUM BOARD
	I = INSULATION
	M = MASONRY
	N = WINDOW WALL
	NR = BULLET RESISTANT
	A = ACOUSTICAL CEILING PANEL
	G = GYPSUM BOARD
	M = METAL DECK

A NEW
PUBLIC SAFETY FACILITY
FOR THE
TOWN OF ACTON
 ACTON, MASSACHUSETTS
 365 MAIN STREET

JHI
JACUNSKI HUMES
ARCHITECTS, LLC
 FENN PLAZA
 121 FENN ROAD
 NEWINGTON, CT 06111
 FAX 860-667-9114
 TEL 860-667-9221

ARCHITECTURAL GENERAL NOTES

PROJ. NO. JH 0243
 SCALE: N.T.S.
 DATE: JUNE 23, 2003
A-0